


INSTRUCTIONS

OPEN GASKETED FILL LID AND FILL WITH BLEACH.
 REQUIRES A FIRM SECURE SEAL ON FILL LID OR
 A VACUUM WILL NOT FORM AND RESERVOIR
 WILL EMPTY PREMATURELY.
 REQUIRES 6-10 % SODIUM HYPOCHLORITE
 (HOUSEHOLD BLEACH)

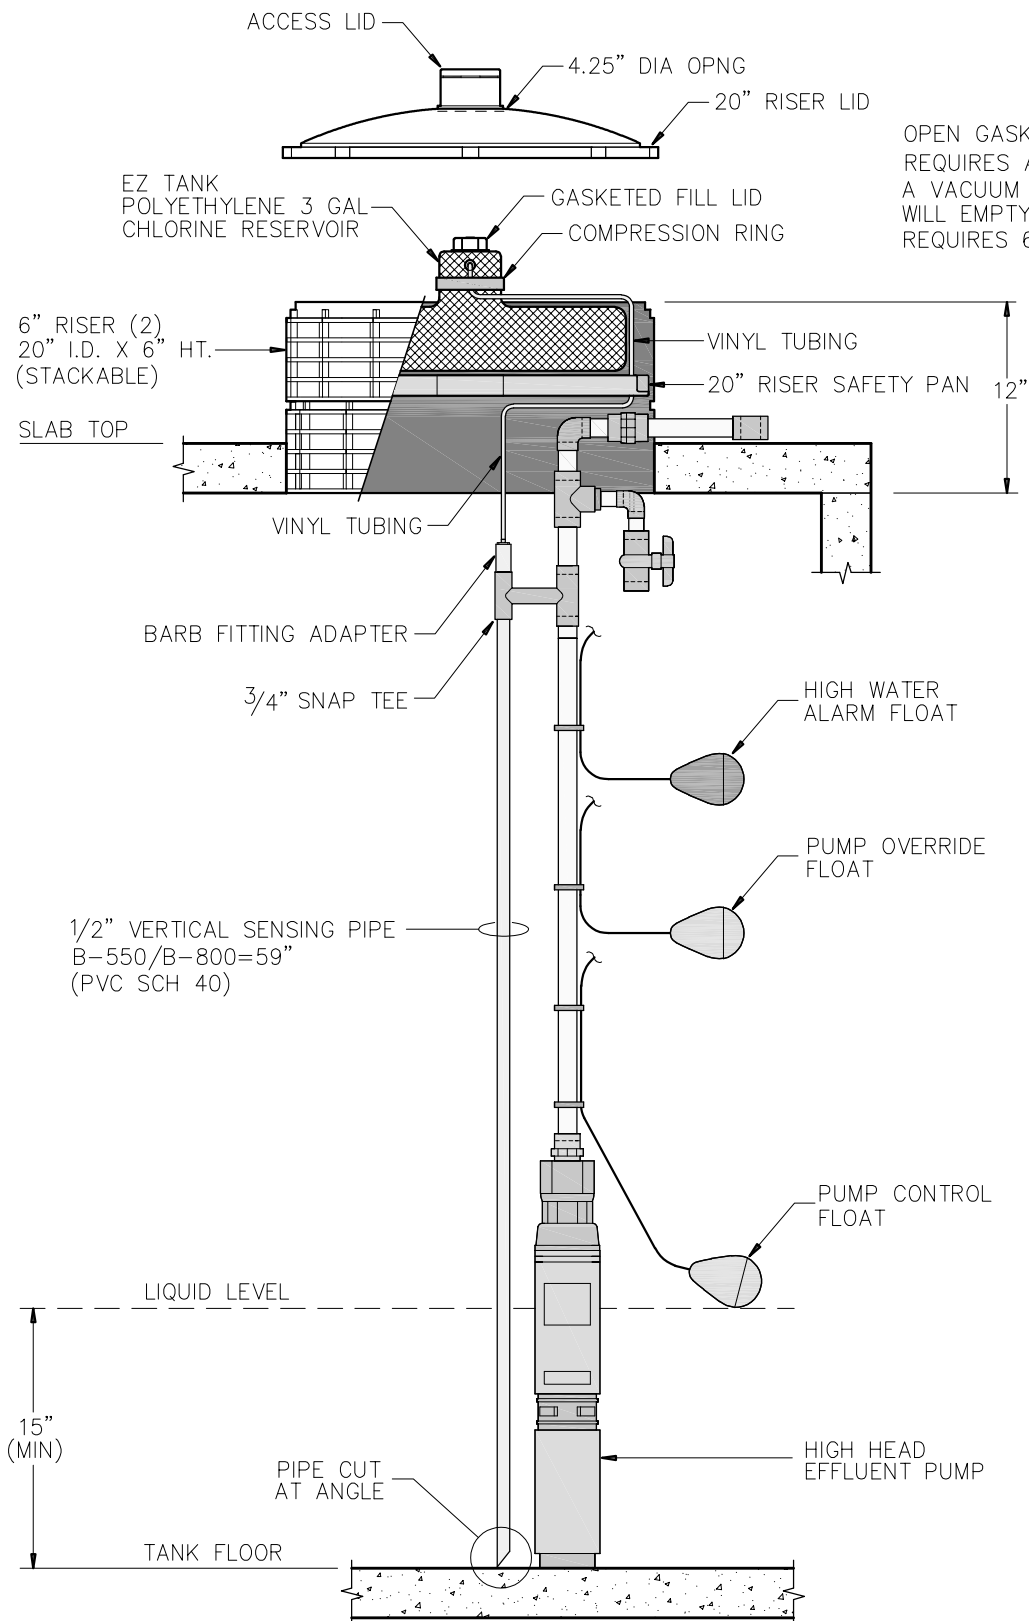

PIPE
 PRECAST PRODUCTS

9235 Main Street #1
 P.O. Box 507
 Needville, Texas, 77461
 1-888-331-5871

LIQUID CHLORINATOR

"Providing Concrete Environmental Solutions"

NC-008-038

Scale: N.T.S.
 * All Dimensions subject to allowable specification tolerances.

Date: 01/24/23

Rev Date:

Approved By: _____ Date: _____